

GENERAL DESCRIPTION The device DAT 3017-V is able to acquire up to 8 analogue input signals. The data are transmitted with MODBUS RTU/MODBUS ASCII protocol on the RS-485 network (RS-232 interface is available).

It is possible to connect on input voltage signals up to ± 10 V.

The device guarantees high accuracy and stable measure versus time and temperature.

To ensure the plant safety, two Watch-Dog timer alarms are provided.

The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions. The DAT 3017-V is in compliance with the Directive 2004/108/EC on the electromagnetic compatibility.

The DAT 3017-V is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market.

The device is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 17.5mm only, allows a high density mounting on EN-50022 standard DIN rail.

COMMUNICATION PROTOCOLS

The DAT 3017-V is designed to work with the MODBUS RTU/MODBUS ASCII protocol: standard protocol in field-bus; allows to directly interface DAT3000 series devices to the larger part of PLCs and SCADA applications available on the market.

For the protocol instructions, refer to the User Guide of the device.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

If the module configuration is unknown, with device powered off, connect the INIT terminal to the GND terminal (ground), at the next power on the device will be auto-configured in the default settings (refer to the User Guide of the device).

Connect power supply, serial bus and analogue inputs as shown in the "Wiring" section.

The "PWR" LED state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

INPUT			Input Accuracy (1)		POWER SUPPLY	
Input type	Min	Max	Voltage	±10 mV	Power supply voltage Reverse polarity protection	10 30 Vdc 60 Vdc max
Voltage			Linearity (1)		Current consumption	30 mA max.
10 V	-10 V	+10 V	Voltage Input Impedance Voltage	± 0.1 % f.s. >/= 1 ΜΩ	ISOLATION Input – RS485 Supply – Input Supply – RS485	2000 Vac 50 Hz, 1 min. 2000 Vac 50 Hz, 1 min. 2000 Vac 50 Hz, 1 min.
		Thermal drift (1)		TIONS		
			Full scale	± 0.005 % / °C	Operative Temperature	-10°C +60°C
			Sample time	0.5 ÷ 1 sec.	Storage Temperature Humidity (not condensed)	-40°C +85°C 0 90 %
			Data Transmission Baud Rate	38.4 Kbps	Maximum Altitude	2000 m Indoor
			Max. distance	1.2 Km – 4000 ft	Category of installation Pollution Degree	II 2
			MECHANICAL SPECIFICATIONS			
						Self-extinguish plastic IP20
						wires with diameter 0.8÷2.1 mm ² /AWG 14-18
						0.5 N m in compliance to DIN rail
						standard EN-50022 about 150 g.
					CERTIFICATIONS	y.
				EMC (for industrial environments)		
					Emission	EN 61000-6-2 EN 61000-6-4
						UL 61010-1
						CSA C22.2 No 61010-1 NRAQ/NRAQ7
						Open Type device Industrial Control
(1) Referred to input Span (difference between max. and min. values)						Equipment E352854

INSTALLATION INSTRUCTIONS


The DAT 3017-V is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case: - If panel temperature exceeds 45°C and at least one of the overload conditions exist.

Make sure that sufficient air flow is provided for the device avoiding to place racewais or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Install the device in a place without vibrations.


Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.

CABLING

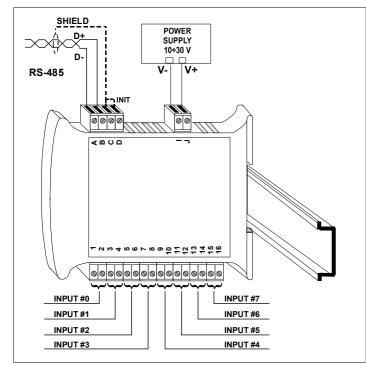

LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION	
PWR	GREEN	ON	Device powered	
		OFF	Device not powered / Wrong RS-485 cabling.	
		FAST BLINK	Communication in progress (blink frequency depends to baud-rate)	
		1 second BLINK	Watch-Dog Alarm condition	

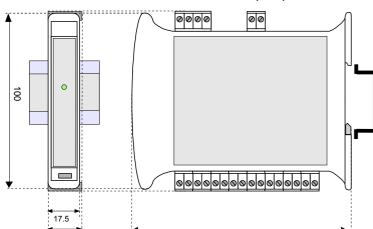

120

20


MECHANICAL DIMENSIONS (mm)



Voltage **INPUT 2** INPUT 0 **INPUT 1 INPUT 3** \overline{O} A 3 6 4 6 **INPUT 4 INPUT 5 INPUT 6 INPUT 7** 0 1 13 ി 1 **(**12) (14 16

NOTE: input channels are not isolated between them.


RS-485 NETWORK



RS-232 NETWORK


INIT


2 4 6 8 0 12 4 19 = Ref.



POWER SUPPLY (*)

ANALOG INPUTS





(*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV

