

GENERAL DESCRIPTION The device DAT 3130 is able to acquire up to 4 digital inputs and to drive up to 4 relay outputs. The data are transmitted with MODBUS RTU/MODBUS ASCII protocol on the RS-485 network. The device guarantees high accuracy and stable measure versus time and temperature.

To ensure the plant safety, two Watch-Dog timer alarms are provided.

The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

The DAT 3130 is in compliance with the Directive 2004/108/EC on the electromagnetic compatibility.

The DAT 3130 is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market.

The device is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 17.5mm only, allows a high density mounting on EN-50022 standard DIN rail.

COMMUNICATION PROTOCOLS

The DAT3130 is designed to work with the MODBUS RTU/MODBUS ASCII protocol: standard protocol in field-bus; allows to directly interface DAT3000 series devices to the larger part of PLCs and SCADA applications available on the market.

For the protocol instructions, refer to the User Guide of the device.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

If the module configuration is unknown, with device powered off, connect the INIT terminal to the GND terminal (ground), at the next power on the device will be auto-configured in the default settings (refer to the User Guide of the device).

Connect power supply, serial bus, digital inputs and relay outputs as shown in the "Wiring" section.

The "PWR" LED state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and under nominal conditions)

| DIGITAL INPUTS | | DIGITAL OUTPUTS | | POWER SUPPLY | |
|---|--|--|---|---|--|
| Number of Channels Input voltage | 4 OFF State : 0÷3 V | Number of Channels | 4 | Power supply voltage Reverse polarity protection Current consumption | 18 30 Vdc 60 Vdc max 120 mA max. |
| (bipolar) Input Impedance Sample time | ON State : 10÷30 V 4.7 KOhm 5 ms | Type of Relay | N.2 Relay SPDT N.2 Relay SPST (N.O.) | ISOLATION On all the ways | 1500 Vac, 50 Hz, 1 min |
| | | Maximum switching power p Minimum load Max. voltage | 2 A @ 250 Vac 2 A @ 30 Vdc 5Vdc, 10mA 250Vac (50 / 60 Hz), 110Vdc | ENVIRONMENTAL CONDI Operative Temperature UL Operative Temperature Storage Temperature Humidity (not condensed) | TIONS -10°C +60°C -10°C +40°C -40°C +85°C 0 90 % |
| | | Dielectric Strength between Dielectric Strength between | 1000 Vac, 50 Hz, 1 min | Category of installation | 2000 m Indoor II 2 |
| | | Data Transmission Baud Rate Max. distance | 38.4 Kbps 1.2 Km – 4000 ft | IP Code Wiring Tightening Torque Mounting | TIONS Self-extinguish plastic IP20 wires with diameter 0.8÷2.1 mm ² /AWG 14-18 0.5 N m in compliance to DIN rail standard EN-50022 about 210 g. |
| | | | | Emission UL US Standard Canadian Standard CCN Typology Classification | Domments) EN 61000-6-2 EN 61000-6-4 UL 61010-1 CSA C22.2 No 61010-1 NRAQ/NRAQ7 Open Type device Industrial Control Equipment E352854 |

INSTALLATION INSTRUCTIONS


The DAT 3130 is suitable to be mounted on DIN rail, in vertical position. For a correct working and a long life of the device, read the following indications.

In case of the devices are mounted side by side, please leave about 5mm between in the following situations:

- Temperature in the cabinet higher than 45 $^\circ\text{C}$ and high supply voltage (<code>>27Vdc</code>).

Avoid to place raceways or other objects which could obstruct the ventilation slits. It is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Avoid to install the devices in a site where vibrations are present.


It is recommended to use shielded cable for connecting signals. The shield must be connected to an earth wire provided for this purpose. Moreover it is suggested to avoid routing conductors near power signal cables.

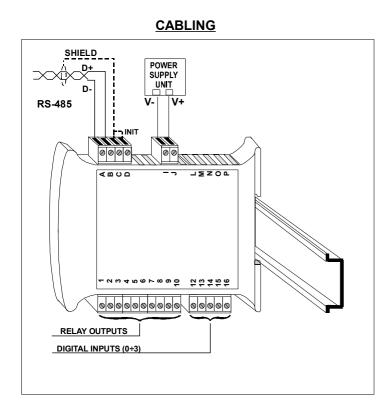


LIGHT SIGNALLING

| LED | COLOUR | STATE | DESCRIPTION |
|-----|--------|-------------------|--|
| PWR | GREEN | ON Device powered | |
| | | OFF | Device not powered or wrong RS-485 connection |
| | | RAPID BLINK | Communication in progress (the blink frequency depends to the Baud-rate) |
| | | SLOW BLINK | ~1 sec Watch-Dog Alarm condition |


MECHANICAL DIMENSIONS (mm)

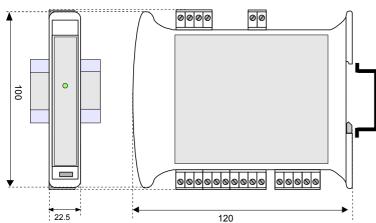


DIGITAL INPUTS





RELAY OUTPUTS






RS-485 NETWORK





POWER SUPPLY(*)



(*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV

ISOLATION STRUCTURE



HOW TO ORDER

DAT 3130

= Mandatory = Optional

ED.03.15 REV.00